


All rights reserved by KUHSE for this technical documents	Bildbeschreibung IMAGE DESCRIPTION										spare		DPP 5(7) Syn. MST 5"/10"PC Incoming gen. CAT 1		4500005501	=DPP +LCG1	page 2
					Date		08.07.03				Elektrim-MEGADEX		KUHSE				
					Check		A. Stellmann				Monde Energy Philippines				43730		437300
	Index		changing		Date		name		Orig.		Ersd.		11.09.03				17 Bl.

A	B	C	D	E	F
---	---	---	---	---	---



5.21

1

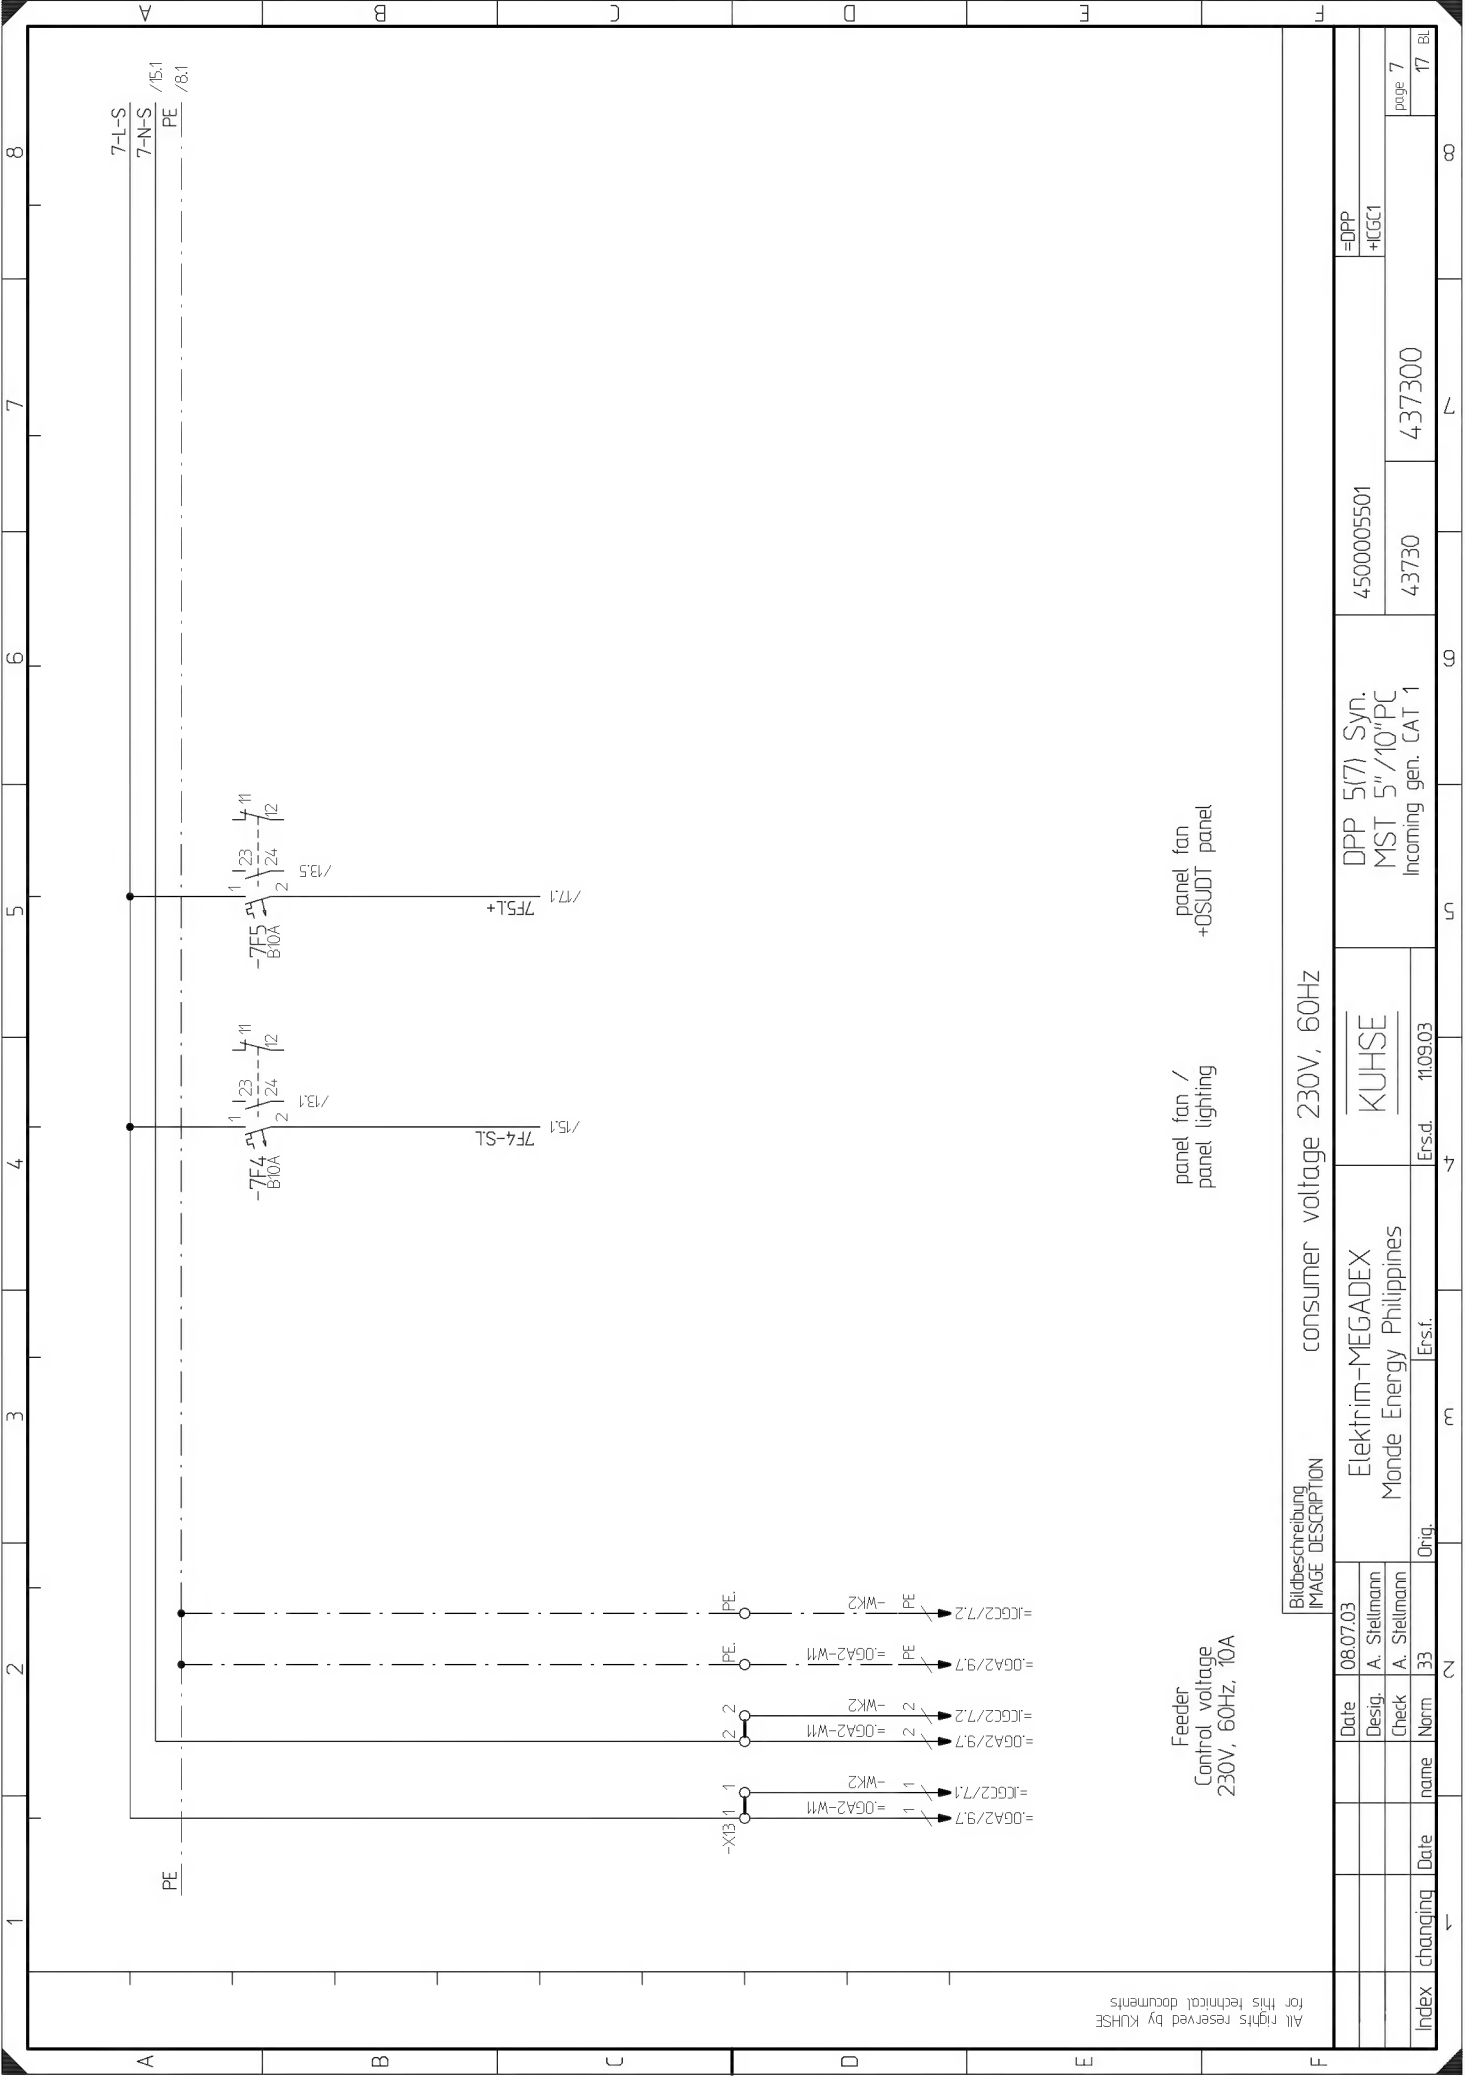


All rights reserved by KUHSE
for this technical documents

Bildbeschreibung IMAGE DESCRIPTION				consumer voltage 230V, 60Hz			
Index	changing	Date	name	Norm	33	Orig.	Ers.f.
Elektrim-MEGADEX Monde Energy Philippines				KUHSE		DPP 5(7) Syn. MST 5"/10"PC Incoming gen. CAT 1	
Date 08.07.03 Desig. A. Stelmann Check A. Stelmann				4500005501		=DPP +CGC1	
				43730		437300	
						page 7	
						17 BL	



Bildbeschreibung IMAGE DESCRIPTION	gen. volt.Caterpillar	genset
		

[illegible]

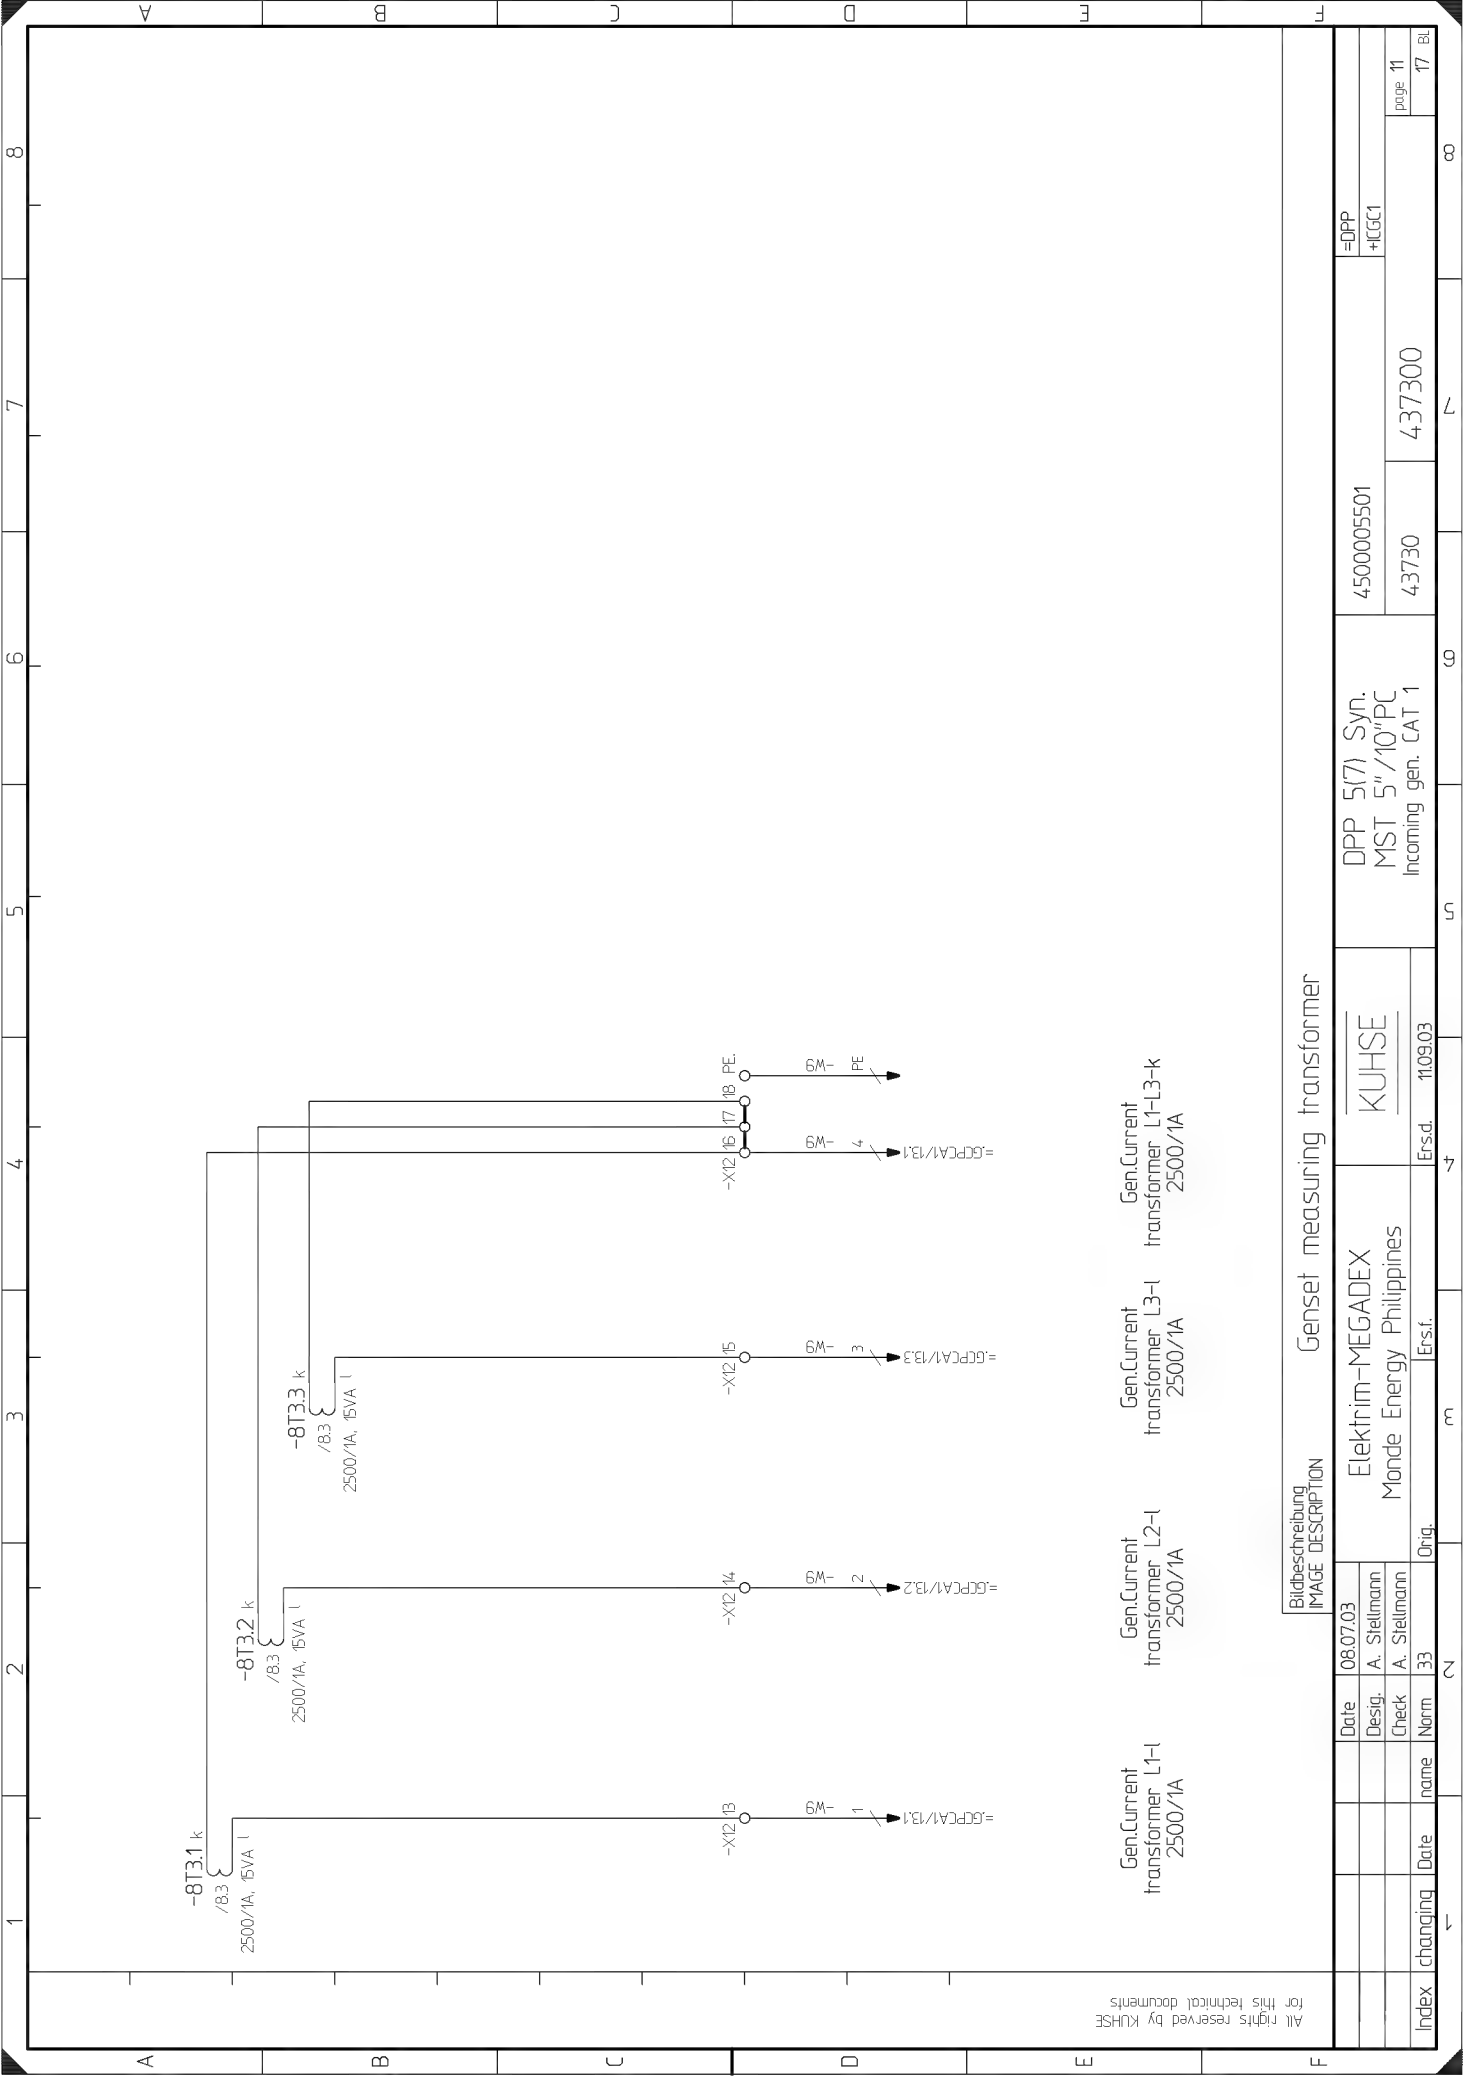

Bildbeschreibung IMAGE DESCRIPTION		Genset measuring transformer	
Index	changing	Date	08.07.03
		Desig.	A. Stelmann
		Check	A. Stelmann
Ers.f.		Orig.	33
Ers.d.		11.09.03	
KUHSE		Elektrim-MEGADEX Monde Energy Philippines	
DPP 5(7) Syn. MST 5"/10"PC Incoming gen. CAT 1		4500005501	
43730		437300	
=DPP +LGC1			
page 11		17 BL	

[illegible]

